


615-893-5514

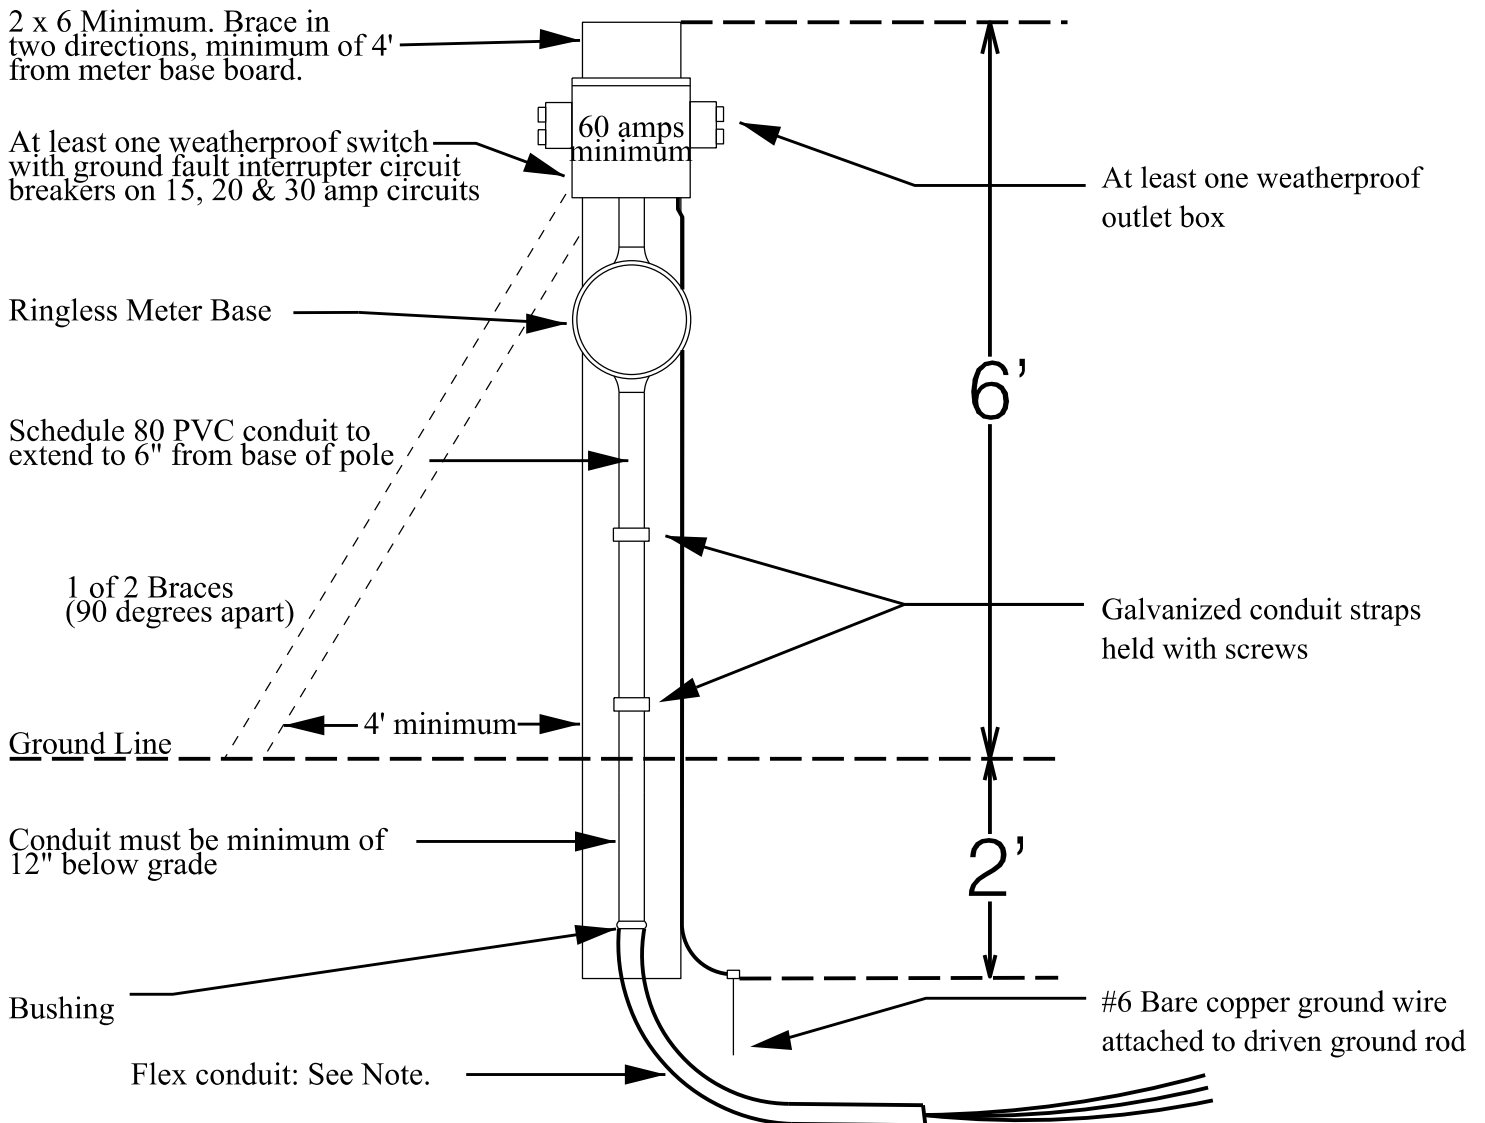

Note:

1. Base of temporary must be within 2' from transformer or vault
2. Flex conduit must be a minimum of 5' in length
3. All leads of URD type wire and ground wire to extend a minimum of 5' from end of conduit.
4. Must have current electrical inspection to be connected by MED.
5. Murfreesboro Electric Department will be final authority.

5/21/2014