


615-893-5514

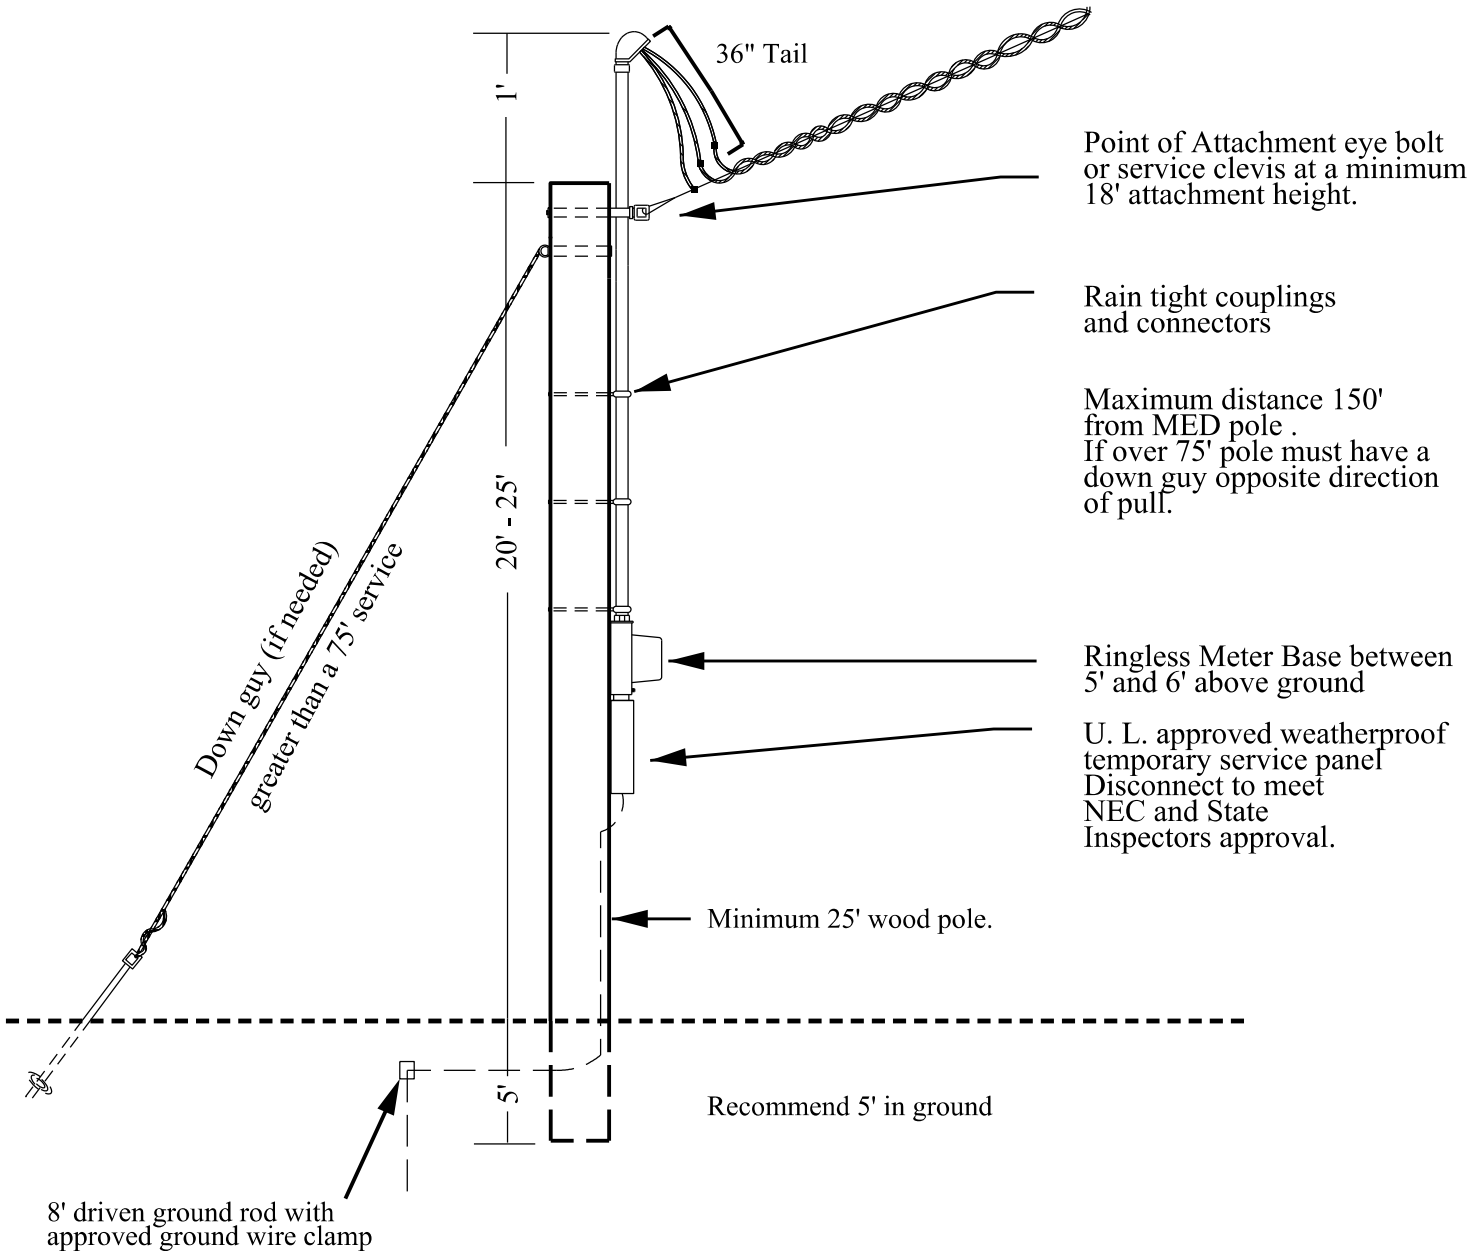

**Note:**

1. Point of service drop attachment minimum height of 18' (at least a 25' wood pole with 4 1/2' in ground) due to truck traffic.
2. Maximum distance 150' from MED pole. If over 75', pole must have a down guy opposite direction of pull.
4. Must have current electrical inspection to be connected by MED.
5. Murfreesboro Electric Department will be final authority.

5/21/2014