


615-893-5514

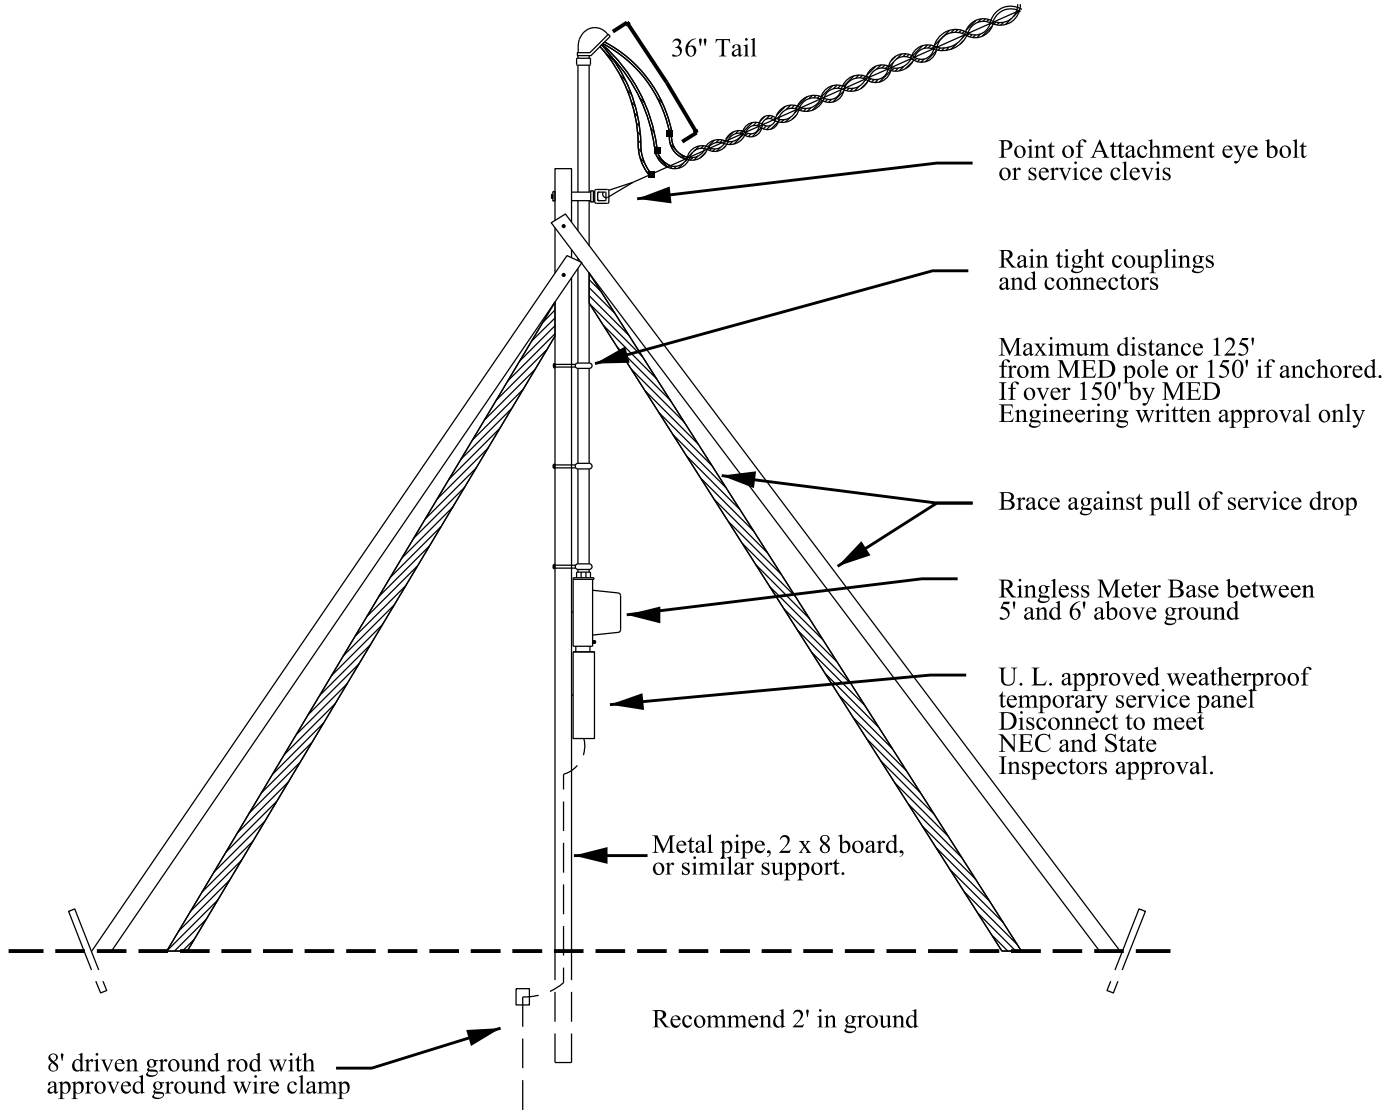

**Note:**

1. Weather head must be 1' above customer's point of service drop attachment.
2. Service entrance conductors to extend 36" out of the weather head.
3. Residential service drop attachment must be a minimum of 12' above ground and provide for the following service drop clearances:
 

yards.....	12 feet
driveways.....	15 feet
public roads.....	18 feet
4. Must have current electrical inspection to be connected by MED.
5. Murfreesboro Electric Department will be final authority.

5/21/2014